



## **FOUNDATION REQUIREMENTS ON EXPANSIVE SOIL**

### *ISSUE.*

#### One- and Two-Story Dwellings of Group R-3, R3.1 and R-4 Occupancies and Accessory Buildings of Group U Occupancy

Foundation systems on expansive soils shall be designed and constructed in a manner that will minimize damage to the building from the movement of the soil. Slab-on-grade and mat-type footings for buildings located on expansive soils shall be designed in accordance with Los Angeles County Building Code Section 1805.8 or such other engineering design based on geotechnical report(s) as approved by the Building Official. When such approved design and methods of construction are not provided, the prescriptive requirements listed below may be used (see attached diagram):

### *POLICY*

- 1 All exterior wall foundations and interior bearing wall foundations shall extend not less than 24 inches and 18 inches, respectively, below undisturbed ground surface or finish grade (certified fill)
- 2 Exterior walls and interior bearing walls shall be supported on continuous foundations.
- 3 Foundations shall be reinforced with a minimum of four continuous horizontal reinforcing bars. At least two ½ inch diameter (# 4-bar) deformed reinforcing bars shall be placed within four inches of the top of the footing and at least two ½ inch diameter (# 4-bar) deformed reinforcing bars shall be placed between 3 inches and 4 inches of the bottom of the footing.
- 4 Foundations for exterior walls and interior bearing walls shall be tied to the floor slabs by reinforcing bars (dowels) having a diameter of not less than ½ inch (# 4-bar) and spaced at intervals not exceeding 16 inches on center. The reinforcing bars shall extend at least 40 bar diameters into the footings and the slab. Dowels may be omitted when slab is a "mono-pour" or designed as an independent "floating slab"
- 5 Concrete floor slabs-on-grade shall be cast over two layers of 2-inch sand fill with a minimum 6-mil moisture barrier membrane sandwiched between the two 2-inch layers. The slab shall be at least 4 inches thick and shall be reinforced with #4-bar at 16 inches on center each way
- 6 The soil below an interior concrete slab shall be saturated with clean water to a depth of 18 inches prior to pouring the concrete.

Note: Construction sites located within designated liquefaction zones shall comply with the more restrictive foundation detailing requirements of BCM 1802.2.7, Article 1

WRITTEN BY



ERIC D BROWNING, P.E  
Associate Civil Engineer

REVIEWED BY



JUAN MADRIGAL  
Senior Civil Engineer

RECOMMENDED BY



HASSAN ALAMEDDINE  
Chief Engineer

APPROVED BY





RAJ PATEL  
Superintendent of Building

Supersedes BCM 1805 8 Article 1 dated 02-11-08.  
Supersedes BCM 1805.8 Article 1 dated 08-14-08.

# FOUNDATION SYSTEM ON EXPANSIVE SOIL FOR 1 OR 2 STORY R-3/R3.1 & ACCESSORY U OCCUPANCIES (NOT IN LIQUEFACTION ZONES)

(PER SECTIONS 1802.2, 1802.2.1, 1805.8)

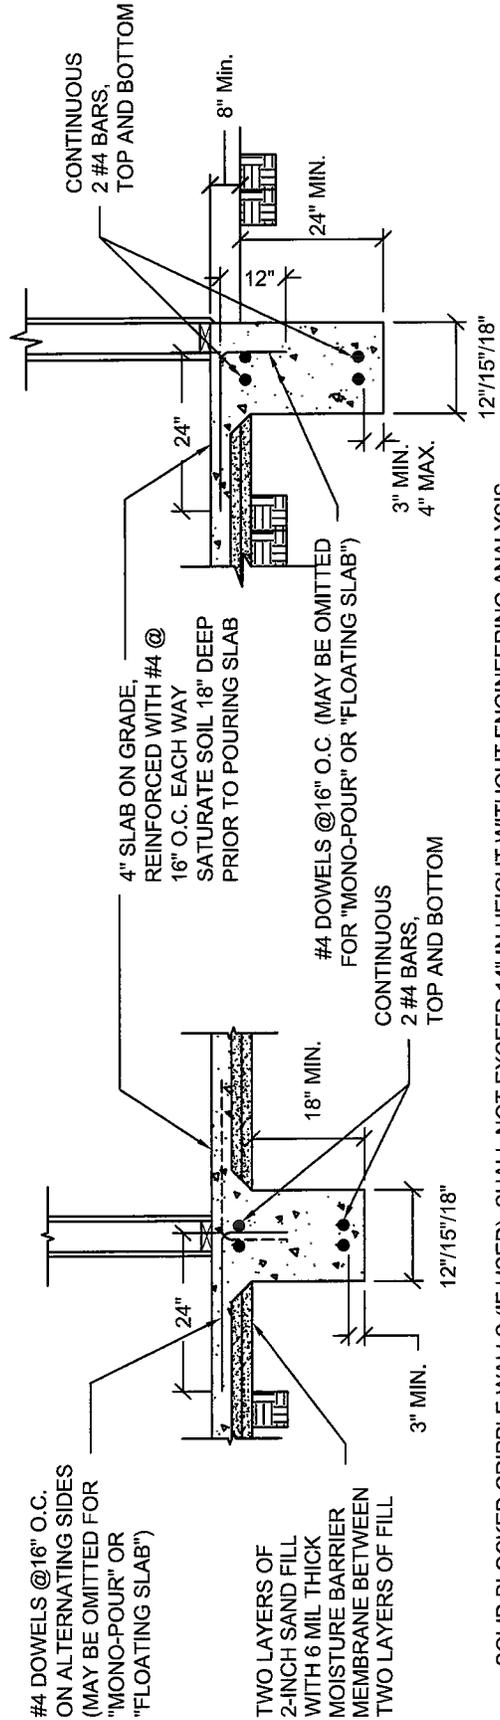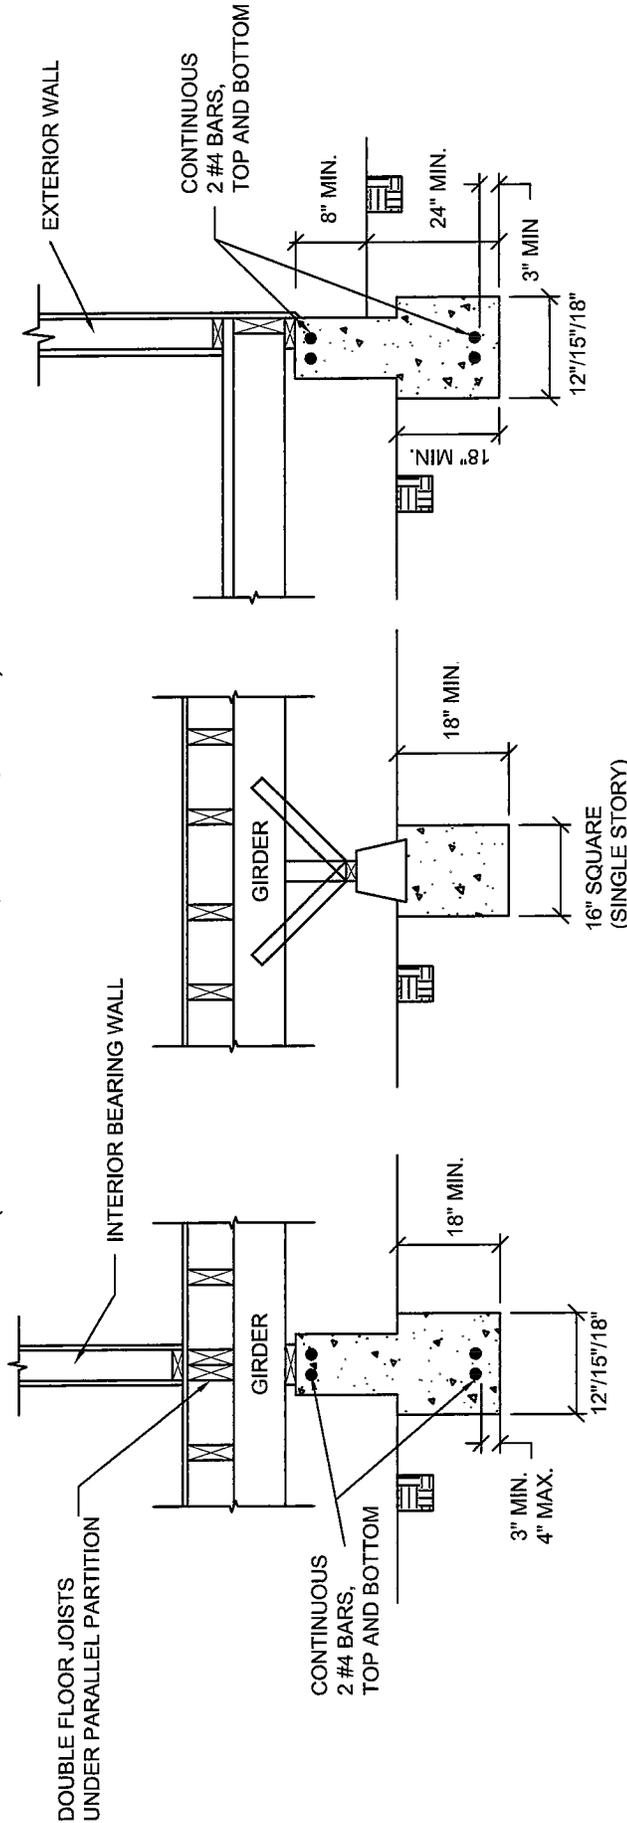

- SOLID BLOCKED CRIPPLE WALLS (IF USED), SHALL NOT EXCEED 14" IN HEIGHT WITHOUT ENGINEERING ANALYSIS.
- DIMENSIONS NOT SHOWN ABOVE ARE THE SAME AS FOR NON-EXPANSIVE SOIL CONDITIONS
- 12"/15"/18" MIN. FOOTING FOR SUPPORTING ONE FLOOR, TWO FLOORS, AND THREE FLOORS RESPECTIVELY
- ANCHOR BOLTS, SHEAR TRANSFER DETAILS, AND OTHER REQUIREMENTS NOT SHOWN FOR CLARITY